



NEMO|etc.

353 Christian Street, Unit #13  
Oxford, CT 06478  
(203) 262-9245

ENGINEER

TEST

CONSULT

**ROOF SYSTEM ASSESSMENT REPORT  
DYNAMIC UPLIFT RESISTANCE PER CSA A123.21**

|                |  |                    |            |
|----------------|--|--------------------|------------|
| CUSTOMER:      | Amrize Building Envelope LLC ( <a href="#">Elevate</a> ) | TEST DATE:         | 2022-10-05 |
| DOCUMENT NO.   | FBP-MARS-3   | PUBLICATION DATE:  | 2025-10-06 |
| TEST PANEL NO. | FBP-D8   | REVISION NO.       | 1          |
| SYSTEM TYPE:   | D-1  | REEVALUATION DATE: | 2028-10-06 |

**MECHANICALLY ATTACHED ROOFING SYSTEM (MARS) SUMMARY**

**ROOFING SYSTEM SUMMARY:**

|                    |  |
|--------------------|--|
| Roof Cover:        | Thermoplastic polyolefin (TPO) single ply, mechanically fixed, in-lap  |
| Insulation (top):  | Polyisocyanurate foam board or gypsum-based board, mechanically fixed  |
| Insulation (base): | (Optional when using 2-inch polyisocyanurate top layer)<br>One or more layer(s), polyisocyanurate foam board, loose-laid |
| Vapor Barrier:     | 6-mil polyethylene or kraft-paper, loose-laid  |
| Thermal Barrier:   | (Optional) Gypsum-, cement- or mineral-wool-based board, loose-laid, adhered or mechanically fixed                       |
| Deck:              | steel  |

**DYNAMIC UPLIFT RESISTANCE PER CSA A123.21:**

| Sustained Test Value |     | Design Value<br>CSA A123.21:20<br>(Test Value x 0.65) |     | Design Value<br>CSA A123.21:14<br>(Test Value ÷ 1.5) |     |
|----------------------|-----|---|-----|--|-----|
| kPa                  | psf | kPa   | psf | kPa  | psf |
| -3,1                 | -65 | -2,0  | -42 | -2,1   | -43 |

**PRODUCTS / APPLICATION:**


|                       |                    |  |  |                   |  |
|-----------------------|--------------------|--|--|-------------------|--|
| Roof Cover:           | Description:       | Membrane composed of polyester reinforcement coated with TPO compound  |  |                   |  |
|                       | Application:       | Mechanically fixed   |  |                   |  |
|                       | Eligible Products: | UltraPly TPO (min. nominal 45-mil) or UltraPly TPO Platinum  |  |                   |  |
| Roof Cover Fasteners: | Description:       | Corrosion resistant screw-type roofing fasteners with steel stress plates  |  |                   |  |
|                       | Fixing Method:     | Parts spaced max. 305-mm (12-in.) o.c. within the min. 152.4-mm (6-in.) wide side laps spaced max. 2.90-m (114-in.) o.c.. Laps sealed with minimum 38.1-mm (1.5-in) heat weld. |  |                   |  |
|                       | Fixing Density:    | 1 part per 0.88 m <sup>2</sup> (9.5 ft <sup>2</sup> )  |  |                   |  |
|                       | Eligible Products: | Elevate Heavy Duty Fasteners with Elevate HD Seam Plates   |  |                   |  |
| Insulation (top):     | Description:       | Polyisocyanurate foam or gypsum-based board  |  |                   |  |
|                       | Application:       | Top layer mechanically fixed   |  |                   |  |
|                       | Eligible Products: | By   | Product  | Min. Thickness    |  |
|                       |                    | Amrize   | Elevate ISOGARD HD   | 13-mm (0.5-in.)   |  |
|                       |                    |  | Elevate ISOGARD GL, ISOGARD CG, ISOGARD HG or ISOGARD HD Composite | 50.8-mm (2-in.)   |  |
|                       |                    | Georgia-Pacific Gypsum LLC   | DensDeck Prime® Roofboard  | 6.4-mm (0.25-in.) |  |
| USG Corporation       |                    | SECUROCK® Gypsum-Fiber Roof Board, SECUROCK® Glass-Mat Roof Board  | 6.4-mm (0.25-in.)  |                   |  |
| Generic               | APA rated OSB      | 11.1-mm (7/16-in.)   |  |                   |  |

**ROOF SYSTEM ASSESSMENT REPORT, DYNAMIC UPLIFT RESISTANCE PER CSA A123.21**

|                |  |                    |            |
|----------------|--|--------------------|------------|
| CUSTOMER:      | Amrize Building Envelope LLC (Elevate) | PUBLICATION DATE:  | 2025-10-06 |
| DOCUMENT NO.   | FBP-MARS-3                             | REVISION NO.       | 1          |
| TEST PANEL NO. | FBP-D8                                 | REEVALUATION DATE: | 2028-10-06 |



| PRODUCTS/APPLICATION (CONTINUED):   |  |   |    |         |                |        |  |
|---|--|---|----|---------|----------------|--------|--|
| Insulation (top) Fasteners:   | Description:   | Corrosion resistant screw-type roofing fasteners with steel stress plates coated with proprietary coating   |    |         |                |        |  |
|   | Fastening Method:  | Fasteners installed through stress plates, positioned to engage the top flanges of the steel deck   |    |         |                |        |  |
|   | Fastening Rate:  | 1 part per 0.37 m <sup>2</sup> (4 ft <sup>2</sup> )<br>8 parts per 1220 x 2438 mm (48 x 96-in.) board   |    |         |                |        |  |
|   | Eligible Products:   | Elevate All-Purpose Fasteners and Elevate Insulation Fastening Plates   |    |         |                |        |  |
| Insulation (base):<br><i>(Optional when using min. 2-inch polyisocyanurate top layer)</i> | Description:   | Polyisocyanurate foam board   |    |         |                |        |  |
|   | Application:   | One or more layer(s), loose-laid with staggered joints  |    |         |                |        |  |
|   | Eligible Products:   | <table border="1"> <thead> <tr> <th>By</th> <th>Product</th> <th>Min. Thickness</th> </tr> </thead> <tbody> <tr> <td>Amrize</td> <td>Elevate ISOGARD GL, ISOGARD CG, ISOGARD HG or ISOGARD HD Composite</td> <td>38.1-mm (1.5-in.)</td> </tr> </tbody> </table> | By | Product | Min. Thickness | Amrize | Elevate ISOGARD GL, ISOGARD CG, ISOGARD HG or ISOGARD HD Composite |
| By  | Product  | Min. Thickness  |    |         |                |        |  |
| Amrize  | Elevate ISOGARD GL, ISOGARD CG, ISOGARD HG or ISOGARD HD Composite | 38.1-mm (1.5-in.)   |    |         |                |        |  |
| Vapour Barrier:   | Description:   | 6-mil polyethylene or kraft-paper   |    |         |                |        |  |
|   | Application:   | Loose-laid with taped joints  |    |         |                |        |  |
|   | Eligible Products:   | 6-mil polyethylene or kraft-paper   |    |         |                |        |  |
| Thermal Barrier:<br><i>(Optional)</i>   | Description:   | Cement-based, gypsum-based or mineral-wool board  |    |         |                |        |  |
|   | Application:   | Loose-laid, adhered or mechanically-fixed   |    |         |                |        |  |
|   | Eligible Products:   | Any approved product acceptable to the named customer and the Authority Having Jurisdiction   |    |         |                |        |  |
| Deck:   | Tested Product:  | Steel   |    |         |                |        |  |

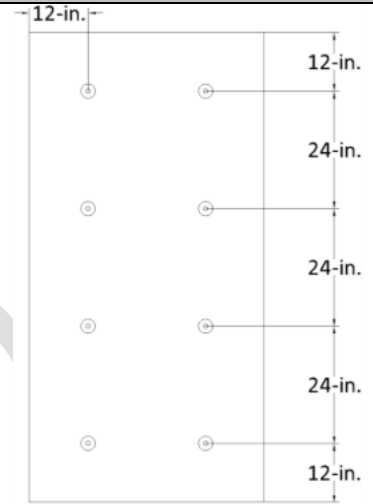

**ROOF SYSTEM ASSESSMENT REPORT, DYNAMIC UPLIFT RESISTANCE PER CSA A123.21**

|                |  |                    |            |
|----------------|--|--------------------|------------|
| CUSTOMER:      | Amrize Building Envelope LLC (Elevate) | PUBLICATION DATE:  | 2025-10-06 |
| DOCUMENT NO.   | FBP-MARS-3                             | REVISION NO.       | 1          |
| TEST PANEL NO. | FBP-D8                                 | REEVALUATION DATE: | 2028-10-06 |



Page 3 of 3

| NOTES:                         |  |
|--------------------------------|--|
| Test Value and Design Value:   | The "Test Value" noted herein reflects the ultimate passing test pressure recorded during testing. The "Design Value" herein reflects the "Test Value" multiplied by a resistance factor of 0.65 (same as "Test Value" divided by a safety factor of 1.5)<br>The "Design Value" should meet or exceed the design pressure requirements of the project, as determined in accordance with the current National Building Code of Canada (NBC) requirements. |
| Equivalence of Other Products: | This report applies only to the products listed as "Eligible Products" herein.   |
| Optional Components:           | Components listed herein as "optional" may be removed from the roof system design with no adverse effect on system dynamic wind uplift performance.  |
| As-Tested Deck:                | Testing utilized 22 ga., Type B (6-inch deck module) steel deck meeting ASTM A653, A792, A1008 or CSSBI 10M standard and having a yield strength of 275 MPa (40-ksi). Alternate deck displaying equivalent strength and fastener-holding capacity (withdrawal resistance) may be specified at the discretion of the Designer of Record to the satisfaction of the Authority Having Jurisdiction.   |

| Point-Load            |                      |     |              |     |
|-----------------------|----------------------|-----|--------------|-----|
| Insulation Fasteners: | Sustained Test Value |     | Design Value |     |
|                       | N                    | lbf | N            | lbf |
|                       | 1157                 | 260 | 752          | 169 |
| Membrane Fasteners:   | Sustained Test Value |     | Design Value |     |
|                       | N                    | lbf | N            | lbf |
|                       | 2747                 | 618 | 1785         | 401 |

**RSAR SCOPE**

Roof System Assessment Reports (RSAR) constitute a summary of allowable products and interfaces used in low-slope roof assemblies based testing in accordance with CSA A123.21 at our ISO/IEC 17025 accredited laboratory.

While RSAR's are reviewed and renewed each 3-years based primarily on report holder declaration, these are not Certification listings, and are not intended to state or imply ongoing quality control / surveillance activities by NEMO at the report holder's facilities.

NEMO ETC, LLC is not, in any way, the Designer of Record for any project on which these RSAR's, or previous versions thereof, is/was used for permitting or design guidance. RSAR's are not to be construed as representing any attributes not specifically listed, nor to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by NEMO ETC, LLC, express or implied, as to any finding or other matter in these RSAR's, or as to any product covered by the RSAR's.

| NEMO ETC CREDENTIALS          |   |                            |
|-------------------------------|---|----------------------------|
| TYPE                          | ENTITY  | REFERENCE                  |
| ISO/IEC 17025 Accreditation   | International Accreditation Service (IAS)           | <a href="#">TL-689</a>     |
| TAS 301 Certification         | Miami-Dade  | <a href="#">21-0409.01</a> |
| Third Party Test Data Program | UL, LLC   | <a href="#">DA2862</a>     |
| Test Lab Listing              | Roofing Contractors Association of British Columbia | <a href="#">RCABC Labs</a> |

| REPORT HISTORY |            |   |                |
|----------------|------------|---|----------------|
| DATE           | EVENT      | NOTES   | AUTHORIZED BY: |
| 2022-09-01     | DRAFT      | For customer review   | RN             |
| 2022-09-05     | FINAL      | After customer review   | RN             |
| 2025-10-03     | DRAFT REV1 | For customer review, Re-format, Re-validation, Update to reflect performance with loose-laid vapor barrier only, as self-adhering vapor barrier option now covered by FBP-MARS-1. | RN             |
| 2025-10-06     | REV1       | After customer review   | RN             |

This report and the data contained therein is the sole property of NEMO|etc. and the named customer. This report shall not be reproduced outside NEMO|etc. except by the named customer without written permission by the named customer, in which case the report shall be reproduced in its entirety.

**END OF REPORT**