



**NEMO|etc.**

353 Christian Street, Unit #13  
Oxford, CT 06478  
(203) 262-9245

ENGINEER

TEST

CONSULT

**ROOF SYSTEM ASSESSMENT REPORT  
DYNAMIC UPLIFT RESISTANCE PER CSA A123.21**

CUSTOMER:	Polyglass USA, Inc.	TEST DATES:	2017-10-05
DOCUMENT NO.	PLYG-PARS-5.1	PUBLICATION DATE:	2025-05-09
TEST PANEL NO.	PLYG-D10	REVISION NO.	2
SYSTEM TYPE:	C-1	REEVALUATION DATE:	2028-05-09

**PARTIALLY ADHERED ROOFING SYSTEM (PARS) SUMMARY**

**ROOFING SYSTEM SUMMARY:**

Cap Ply:	SBS modified bitumen, torch-applied
Ply:	(Optional) SBS modified bitumen, torch-applied
Base Ply:	SBS modified bitumen, torch-applied
Coverboard:	Gypsum-based board, mechanically fixed
Insulation (base):	Polyisocyanurate foam insulation board, loose-laid
Vapor Barrier:	SBS modified bitumen, self-adhering
Thermal Barrier:	(Optional) Any approved type, loose-laid, adhered or mechanically fixed
Deck:	Steel

**DYNAMIC UPLIFT RESISTANCE PER CSA A123.21:**

Sustained Test Value		Design Value CSA A123.21:20 (Test Value x 0.65)		Design Value CSA A123.21:14 (Test Value ÷ 1.5)	
		kPa	psf	kPa	psf
-5,2	-108	-3,4	-70	-3,4	-72

**PRODUCTS / APPLICATION:**

Cap Ply:	Description:	Membrane composed of fiberglass, polyester or fiberglass/polyester composite reinforcement coated with SBS modified bitumen
	Application:	Torch-applied
	Eligible Products:	Elastoshield HT G, Elastoshield HT G FR, Elastoflex V, Elastoflex V G, Elastoflex V G FR, Elastoflex S6, Elastoflex VP, Elastoflex S6 HP, Elastoflex VP HP, Elastoflex S6 G, Elastoflex VP G, Elastoflex S6 G FR, Elastoflex VP G FR, Elastoshield TS G, Elastoshield TS G FR, Polyfresko G SBS or Polyfresko G SBS FR
Ply: (Optional)	Description:	Membrane composed of fiberglass, polyester or fiberglass/polyester composite reinforcement coated with SBS modified bitumen
	Application:	Torch-applied
	Eligible Products:	One or more plies Elastobase V, Elastoflex V, Elastoflex S6, Elastoflex VP, Elastoflex S6 HP, Elastoflex VP HP, Elastoshield VP HT or Elastoshield TS


**ROOF SYSTEM ASSESSMENT REPORT, DYNAMIC UPLIFT RESISTANCE PER CSA A123.21**

CUSTOMER:	Polyglass USA, Inc.	PUBLICATION DATE:	2025-05-09
DOCUMENT NO.	PLYG-PARS-5.1	REVISION NO.	2
		REEVALUATION DATE:	2028-05-09



**NEMO|etc.®**

PRODUCTS / APPLICATION:				
Base Ply:	Description:	Membrane composed of fiberglass, polyester or fiberglass/polyester composite reinforcement coated with SBS modified bitumen		
	Application:	Torch-applied		
	Eligible Products:	Elastobase V, Elastoflex V, Elastoflex S6, Elastoflex VP, Elastoflex S6 HP, Elastoflex VP HP, Elastoshield VP HT or Elastoshield TS		
Coverboard:	Description:	Gypsum-based board		
	Dimensions:	Min. 1.2 x 2.4-m (4 x 8 ft) or 1.2 x 1.2-m (4 x 4 ft) x thickness noted below		
	Application:	Mechanically fixed		
	Eligible Products:	<b>By</b>	<b>Product</b>	<b>Min. Thickness</b>
		Georgia-Pacific Gypsum	DensDeck Prime	12.7-mm (0.5-inch)
		United States Gypsum Company	SECUROCK Gypsum-Fiber Roof Board	12.7-mm (0.5-inch)
Coverboard Fasteners:	Description:	Corrosion resistant screw-type roofing fasteners with steel stress plates		
	Fastening Method:	Fasteners installed through stress plates to engage the top flanges of the steel deck		
	Fastener Density:	1 per 2.0 ft <sup>2</sup> (16 parts per 4x8 ft board or 8 parts per 4x4 ft board)		
		<b>By</b>	<b>Product</b>	
			Polyglass	#14 Polygrip or #15 Polygrip with Polygrip Hex Plate
			Altenloh, Brink & Co US	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate
		OMG, Inc.	OMG Heavy Duty Fastener or OMG XHD with OMG 3 in. Ribbed Galvalume Plate (Flat), OMG AccuTrac Flat Bottom Plate or OMG 3" Galvalume Steel Plate	
		SFS Group USA	Dekfast DF-#14-PH3 or DF-#15-PH3 with Dekfast PLT-R-3 or PLT-H-2-7/8	
Insulation:	Description:	Polyisocyanurate foam insulation board laminated on both sides with fiber reinforced felt or coated glass facer		
	Application:	One or more layers, loose-laid		
	Thickness:	Minimum 38-mm (1.5-inch)		
	Eligible Products:	Polytherm, Polytherm G, Polytherm H or Polytherm K		

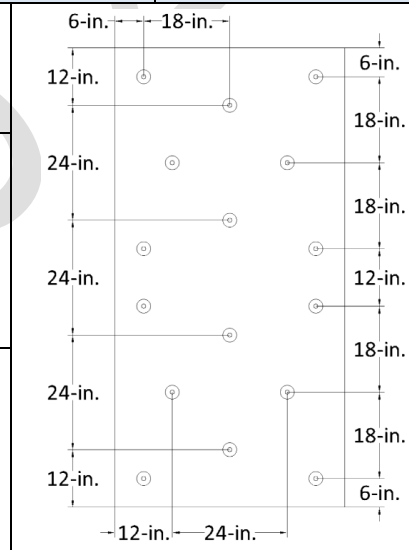

**ROOF SYSTEM ASSESSMENT REPORT, DYNAMIC UPLIFT RESISTANCE PER CSA A123.21**

CUSTOMER:	Polyglass USA, Inc.	PUBLICATION DATE:	2025-05-09
DOCUMENT NO.	PLYG-PARS-5.1	REVISION NO.	2
		REEVALUATION DATE:	2028-05-09



**NEMO|etc.®**

Page 3 of 4

PRODUCTS / APPLICATION:		
Vapour Barrier:	Description:	Membrane composed of a fiberglass reinforcement coated with SBS modified bitumen
	Application:	Self-adhering
	Eligible Products:	Elastobase SA or Elastoflex SA V
Thermal Barrier: (Optional)	Description:	Cement-based, gypsum-based or mineral-wool board
	Application:	Loose-laid, adhered or mechanically-attached
	Eligible Products:	Any approved product acceptable to Tremco and the Authority Having Jurisdiction
Deck:	As-Tested:	Steel roof deck

NOTES:	
Test Value and Design Value:	The "Test Value" noted herein reflects the ultimate passing test pressure recorded during testing. The "Design Value" herein reflects the "Test Value" multiplied by a resistance factor of 0.65 (same as "Test Value" divided by a safety factor of 1.5) The "Design Value" should meet or exceed the design pressure requirements of the project, as determined in accordance with the current National Building Code of Canada (NBC) requirements.
Equivalence of Other Products:	This report applies only to the products listed as "Eligible Products" herein.
Optional Components:	Components listed herein as "optional" may be removed from the roof system design with no adverse effect on system dynamic wind uplift performance.
As-Tested Deck:	Testing utilized 22 ga., Type B (6-inch deck module) steel deck meeting ASTM A653, A792, A1008 or CSSBI 10M standard and having a yield strength of 275 MPa (40-ksi). Alternate deck displaying equivalent strength and fastener-holding capacity (withdrawal resistance) may be specified at the discretion of the Designer of Record to the satisfaction of the Authority Having Jurisdiction.
Fastener Point-Load:	The insulation fastener point-loads resisted during this test are: <ul style="list-style-type: none"> <li>• Test Value: 961 N (216 lbf)</li> <li>• Design Value: 650 N (144 lbf)</li> </ul>

**ROOF SYSTEM ASSESSMENT REPORT, DYNAMIC UPLIFT RESISTANCE PER CSA A123.21**

CUSTOMER:	Polyglass USA, Inc.	PUBLICATION DATE:	2025-05-09
DOCUMENT NO.	PLYG-PARS-5.1	REVISION NO.	2
		REEVALUATION DATE:	2028-05-09



**NEMO|etc.®**

Page 4 of 4

**RSAR SCOPE**

**Roof System Assessment Reports (RSAR)** constitute a summary of allowable products and interfaces used in low-slope roof assemblies based testing in accordance with CSA A123.21 at our ISO/IEC 17025 accredited laboratory.

While RSAR's are reviewed and renewed each 3-years based primarily on report holder declaration, these are not Certification listings, and are not intended to state or imply ongoing quality control / surveillance activities by NEMO at the report holder's facilities.

NEMO ETC, LLC is not, in any way, the Designer of Record for any project on which these RSAR's, or previous versions thereof, is/was used for permitting or design guidance. RSAR's are not to be construed as representing any attributes not specifically listed, nor to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by NEMO ETC, LLC, express or implied, as to any finding or other matter in these RSAR's, or as to any product covered by the RSAR's.

**NEMO ETC CREDENTIALS**

TYPE	ENTITY	REFERENCE
ISO/IEC 17025 Accreditation	International Accreditation Service (IAS)	<a href="#">TL-689</a>
TAS 301 Certification	Miami-Dade	<a href="#">21-0409.01</a>
Third Party Test Data Program	UL, LLC	<a href="#">DA2862</a>
Test Lab Listing	Roofing Contractors Association of British Columbia	<a href="#">RCABC Labs</a>

**REPORT HISTORY**

DATE	EVENT	NOTES	AUTHORIZED BY:
2018-02-26	FINAL	None	RN
2021-02-19	REV1	Re-Validation	RN
		Name change: Polyglass HT Base 650 to Elastoshield VP HT	
		Add: Elastobase SA	
2025-05-09	REV2	Customer directed edits; combine with PLYG-PARS-5.1	RN

This report and the data contained therein is the sole property of NEMO|etc. and the named customer. This report shall not be reproduced outside NEMO|etc. except by the named customer without written permission by the named customer, in which case the report shall be reproduced in its entirety.

**END OF REPORT**