



NEMO|etc.

353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

TEST

CONSULT

ROOF SYSTEM ASSESSMENT REPORT DYNAMIC UPLIFT RESISTANCE PER CSA A123.21			
CUSTOMER:	Tremco CPG, Inc.	TEST DATES:	2025-06-30 (by others)
DOCUMENT NO.	TRM-PARS-5	PUBLICATION DATE:	2025-08-12
TEST PANEL NO.	1 (by others)	REVISION NO.	0
SYSTEM TYPE:	B-1	REEVALUATION DATE:	2028-08-12

PARTIALLY ADHERED ROOFING SYSTEM (PARS) SUMMARY

ROOFING SYSTEM SUMMARY:

Roof Cover:	Thermoplastic, bareback or fleece backed single ply, adhesive applied
Coverboard:	Gypsum-based board, adhesive-applied
Insulation (mid):	(Optional) Polyisocyanurate foam board, adhesive-applied
Insulation (base):	Polyisocyanurate foam board, mechanically attached
Vapor Barrier:	Any approved type, loose-laid, adhered or mechanically fixed
Thermal Barrier:	(Optional) Any approved type, loose-laid, adhered or mechanically fixed
Deck:	Wood

DYNAMIC UPLIFT RESISTANCE PER CSA A123.21:

Sustained Test Value		Design Value CSA A123.21:20 (Test Value x 0.65)		Design Value CSA A123.21:14 (Test Value ÷ 1.5)	
kPa	psf	kPa	psf	kPa	psf
-3,2	-66	-2,1	-43	-2,1	-44

PRODUCTS / APPLICATION:

Roof Cover:	Description:	Membrane composed of polyester reinforcement coated with proprietary thermoplastic compound, with or without a fleece backing			
	Application:	Fully-adhered (see adhesive options below)			
	Eligible Products:	TPA	TPA FB	TremPly KEE	TremPly KEE FB
		TPA Bonding Adhesive, contact application, 0.83 gal/square per surface	TPA Bonding Adhesive, wet-lay, 1.0 gal/square	TremPly KEE LV Bonding Adhesive, contact application, 0.5 gal/square per surface	TremPly KEE FB Bonding Adhesive, wet-lay, 1.0 gal/square
		TPA LV Single Ply Bonding Adhesive, contact application, 0.83 gal/square per surface	Tremco Fleece Backed WB Single Ply Bonding Adhesive, wet-lay, 1.0 gal/square		TremPly KEE FB WB II Bonding Adhesive, wet-lay, 0.85 to 1.0 gal/square (to DensDeck Prime only)
		Tremco LR Adhesive, spatter-applied, 4 lbs/square		Tremco LR Adhesive, spatter-applied, 4 lbs/square	
	POWERply Endure BIO Adhesive TF, wet-lay, 2.0 to 3.0 gal/square		POWERply Endure BIO Adhesive TF, wet-lay, 2.0 to 3.0 gal/square		
				hot asphalt or THERMastic 80, wet-lay, 25 lbs/square	

ROOF SYSTEM ASSESSMENT REPORT, DYNAMIC UPLIFT RESISTANCE PER CSA A123.21

CUSTOMER: Tremco CPG, Inc. PUBLICATION DATE: 2025-08-12
 DOCUMENT NO. TRM-PARS-5 REVISION NO. 0
 REEVALUATION DATE: 2028-08-12




PRODUCTS / APPLICATION:					
Coverboard:	Description:	Gypsum-based board			
	Application:	Adhesive-applied			
	Eligible Products:	By	Product	Thickness	
		Georgia-Pacific Gypsum	DensDeck Prime or DensDeck StormX Prime		Min. 6.3-mm (0.25-inch)
United States Gypsum	SECUROCK Gypsum-Fiber Roof Board				
Coverboard Adhesive:	Description:	Polyurethane based insulation adhesive			
	Application Rate:	Continuous ribbons, 305-mm (12-inch) on-center			
	Eligible Products:	By	Product		
		Tremco CPG	Low Rise Foam Insulation Adhesive or Low Rise Foam Insulation Adhesive (BG)		
HB Fuller Company	Millennium One Step Foamable Adhesive or Millennium PG-1 Pump Grade Adhesive				
Insulation, mid layer(s): (Optional)	Description:	Polyisocyanurate foam board laminated on both sides with fiber reinforced felt or coated fiberglass facer			
	Application:	One or more layer(s), adhesive-applied			
	Eligible Products:	By	Product	Dimensions	
		Tremco CPG	Trisotech, Trisotech G or Trisotech CGF		Max. 1.2 x 1.2-m (4 x 4 ft) x min. 25-mm (1-inch) thick
		Atlas Roofing	ACFoam II or ACFoam III		
Johns Manville		ENRGY 3			
Insulation, mid layer, Adhesive:	Description:	Polyurethane based insulation adhesive			
	Application Rate:	Continuous ribbons, 305-mm (12-inch) on-center			
	Eligible Products:	By	Product		
		Tremco CPG	Low Rise Foam Insulation Adhesive or Low Rise Foam Insulation Adhesive (BG)		
HB Fuller Company	Millennium One Step Foamable Adhesive or Millennium PG-1 Pump Grade Adhesive				
Insulation, base layer:	Description:	Polyisocyanurate foam board laminated on both sides with fiber reinforced felt or coated fiberglass facer			
	Dimensions:	Min. 1.2 x 2.4-m (4 x 8 ft) or 1.2 x 1.2-m (4 x 4 ft) x thickness noted below			
	Application:	Optional base layer(s) loose laid, top layer mechanically fixed			
	Eligible Products:	By	Products	Min. Top Layer Thickness	
		Tremco CPG	Trisotech, Trisotech G or Trisotech CGF		50.8-mm (2-inch)
Atlas Roofing		ACFoam II or ACFoam III			
Johns Manville		ENRGY 3			

ROOF SYSTEM ASSESSMENT REPORT, DYNAMIC UPLIFT RESISTANCE PER CSA A123.21

CUSTOMER:	Tremco CPG, Inc.	PUBLICATION DATE:	2025-08-12
DOCUMENT NO.	TRM-PARS-5	REVISION NO.	0
		REEVALUATION DATE:	2028-08-12



PRODUCTS / APPLICATION:				
Insulation Fasteners:	Description:	Corrosion resistant screw-type roofing fasteners with steel stress plates		
	Fastening Method:	Fasteners installed through stress plates to engage the top flanges of the steel deck		
	Fastener Density:	1 per 3.2 ft ² (10 parts per 4x8 ft board or 5 parts per 4x4 ft board)		
	Eligible Products:	By	Product	
		Tremco CPG	Tremco #15 EHD with Tremco 3" Metal Insulation Plate	
Altenloh, Brink & Co US	Trufast #15 EHD with Trufast 3" Metal Insulation Plate			
Vapour Barrier:	Description:	Min. 6-mil polyethylene or other vapor barrier		
	Application:	Loose-laid, adhered or mechanically-attached		
	Eligible Products:	Any approved product acceptable to Tremco and the Authority Having Jurisdiction		
Thermal Barrier: (Optional)	Description:	Cement-based, gypsum-based or mineral-wool board		
	Application:	Loose-laid, adhered or mechanically-attached		
	Eligible Products:	Any approved product acceptable to Tremco and the Authority Having Jurisdiction		
Deck:	As-Tested:	Plywood roof deck		

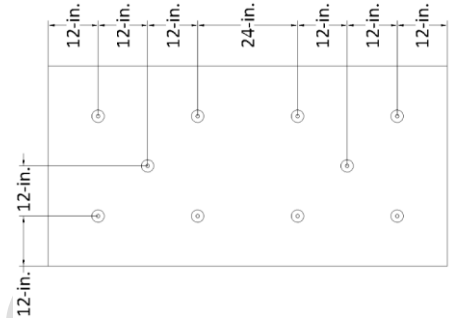

NOTES:				
Test Value and Design Value:	The "Test Value" noted herein reflects the ultimate passing test pressure recorded during testing. The "Design Value" herein reflects the "Test Value" multiplied by a resistance factor of 0.65, or divided by a safety factor of 1.5. The "Design Value" should meet or exceed the design pressure requirements of the project, as determined in accordance with the current National Building Code of Canada (NBC) requirements.			
Equivalence of Other Products:	This report applies only to the products listed as "Eligible Products" herein.			
Optional Components:	Components listed herein as "optional" may be removed from the roof system design with no adverse effect on system dynamic wind uplift performance.			
As-Tested Deck:	Testing utilized plywood, APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category, CDX. Alternate deck displaying equivalent strength and fastener-holding capacity (withdrawal resistance) may be specified at the discretion of the Designer of Record to the satisfaction of the Authority Having Jurisdiction.			
Fastener Point-Loads:	Point-Load			
	Sustained Test Value		Design Value	
	N	lbf	N	lbf
	939	211	611	137

ROOF SYSTEM ASSESSMENT REPORT, DYNAMIC UPLIFT RESISTANCE PER CSA A123.21

CUSTOMER:	Tremco CPG, Inc.	PUBLICATION DATE:	2025-08-12
DOCUMENT NO.	TRM-PARS-5	REVISION NO.	0
		REEVALUATION DATE:	2028-08-12



RSAR SCOPE

Roof System Assessment Reports (RSAR) constitute a summary of allowable products and interfaces used in low-slope roof assemblies based testing in accordance with CSA A123.21 at our ISO/IEC 17025 accredited laboratory.

While RSAR's are reviewed and renewed each 3-years based primarily on report holder declaration, these are not Certification listings, and are not intended to state or imply ongoing quality control / surveillance activities by NEMO at the report holder's facilities.

NEMO ETC, LLC is not, in any way, the Designer of Record for any project on which these RSAR's, or previous versions thereof, is/was used for permitting or design guidance. RSAR's are not to be construed as representing any attributes not specifically listed, nor to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by NEMO ETC, LLC, express or implied, as to any finding or other matter in these RSAR's, or as to any product covered by the RSAR's.

NEMO ETC CREDENTIALS

TYPE	ENTITY	REFERENCE
ISO/IEC 17025 Accreditation	International Accreditation Service (IAS)	TL-689
TAS 301 Certification	Miami-Dade	21-0409.01
Third Party Test Data Program	UL, LLC	DA2862
Test Lab Listing	Roofing Contractors Association of British Columbia	RCABC Labs

REPORT HISTORY

DATE	EVENT	NOTES	AUTHORIZED BY:
2025-07-14	DRAFT 1	For customer review	RN
2025-08-12	FINAL	After customer review	RN

This report and the data contained therein is the sole property of NEMO|etc. and the named customer. This report shall not be reproduced outside NEMO|etc. except by the named customer without written permission by the named customer, in which case the report shall be reproduced in its entirety.

END OF REPORT

